
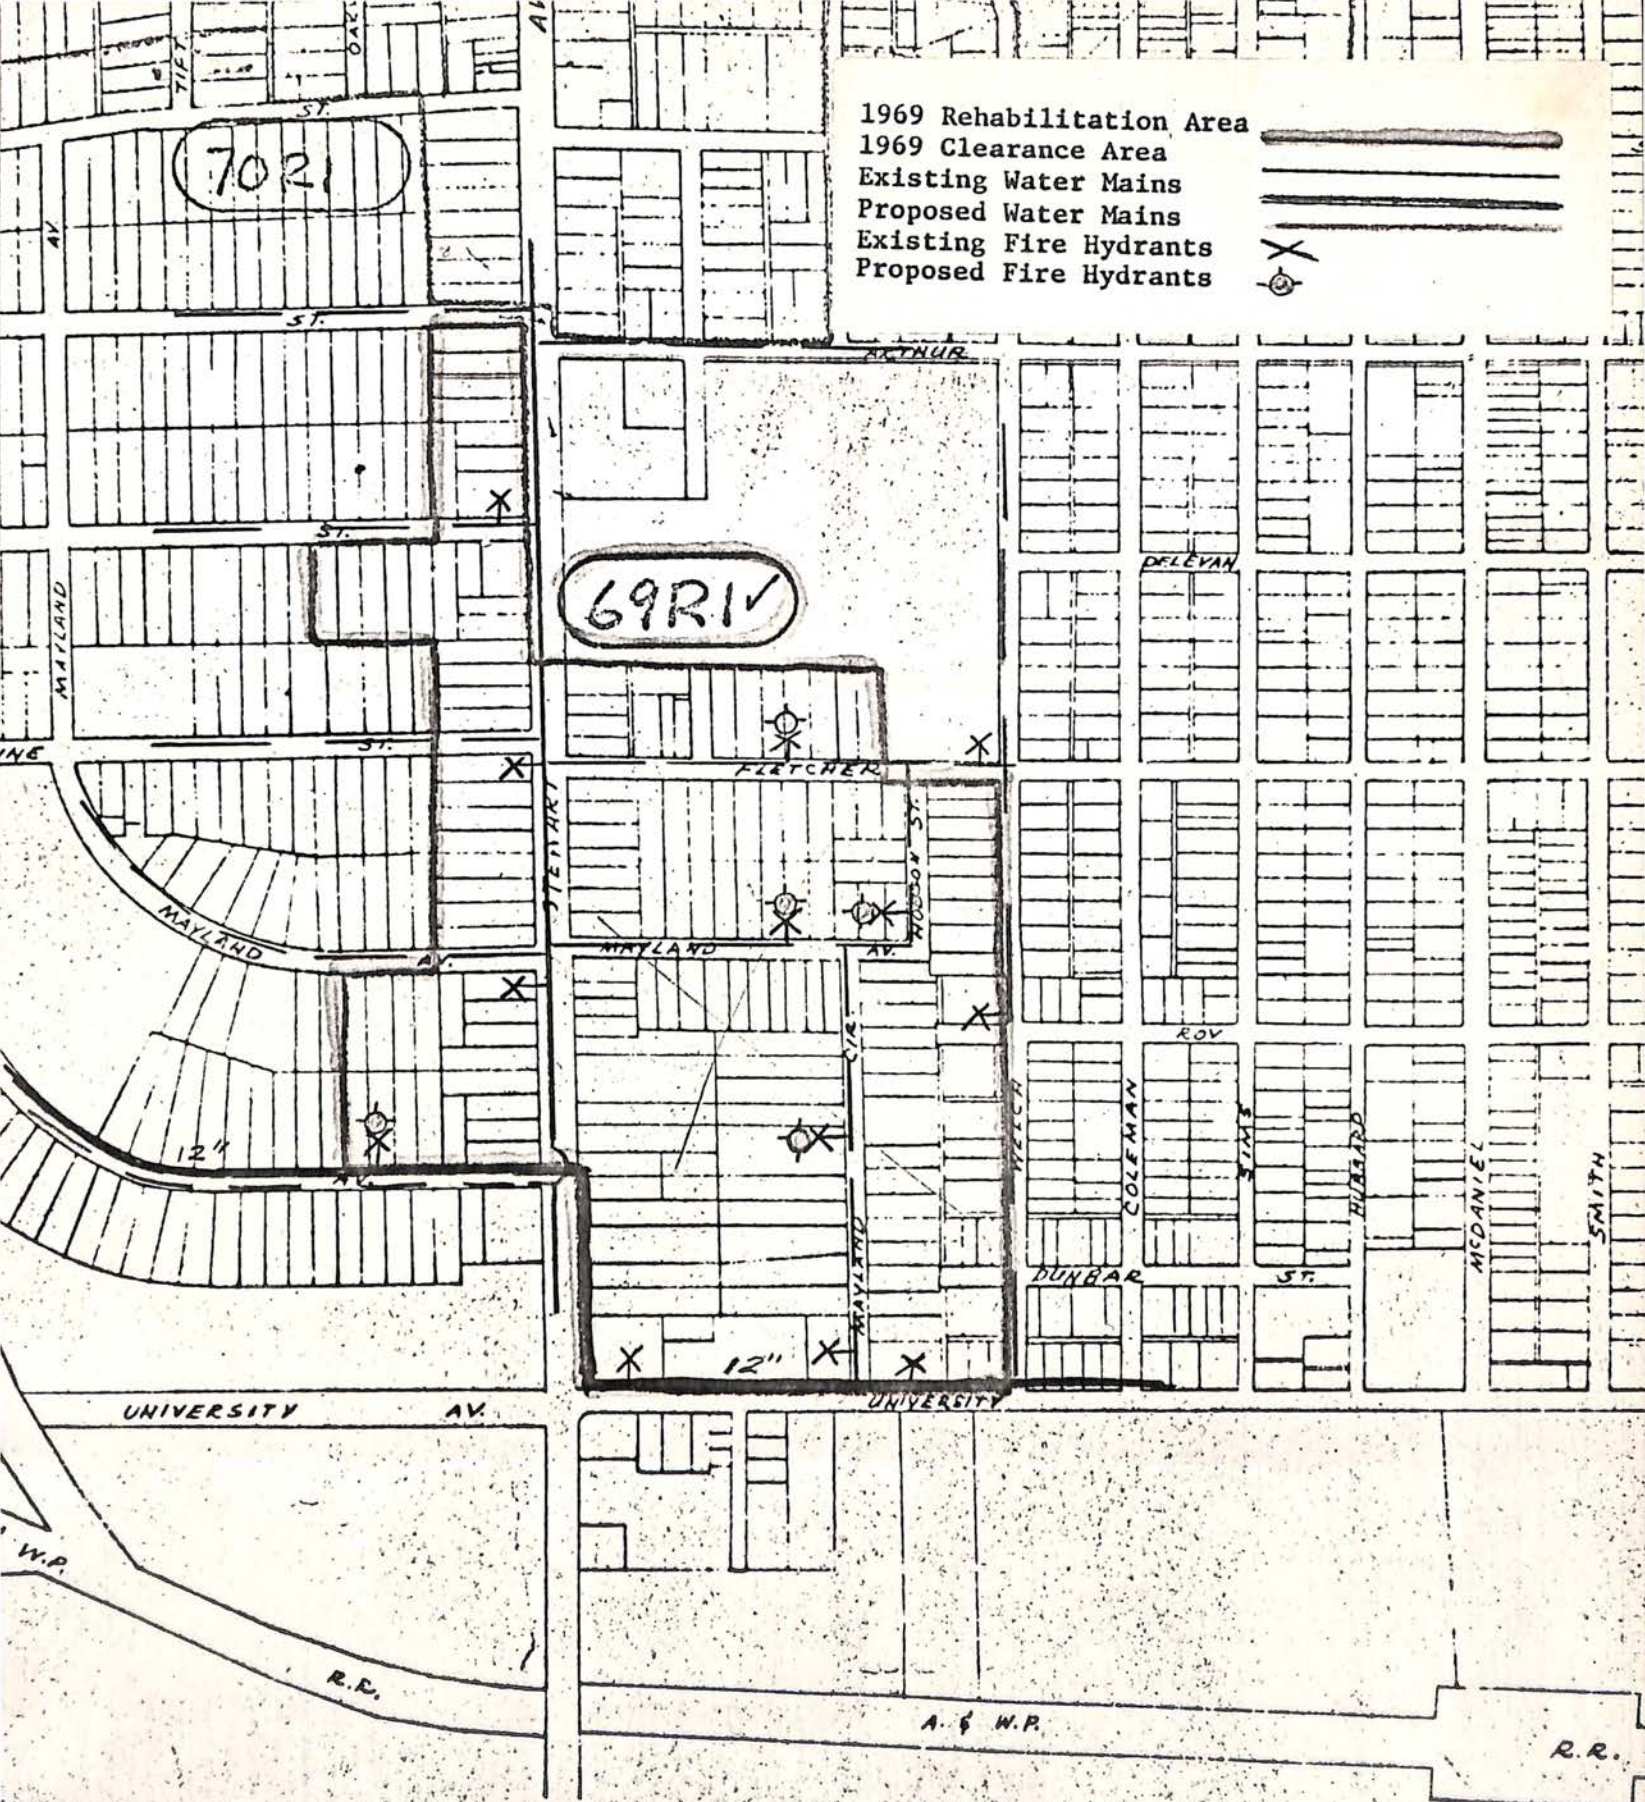


1969 Rehabilitation Area  
 1969 Clearance Area  
 Existing Water Mains  
 Proposed Water Mains  
 Existing Fire Hydrants  
 Proposed Fire Hydrants

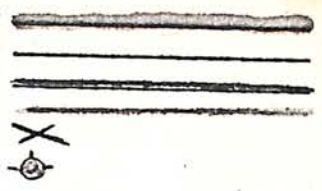


7021


69R1V

ATLANTA WATER WORKS  
 Paul Weir, General Manager  
  
 Division of Engineering  
 C. W. Cline, Chief Engineer




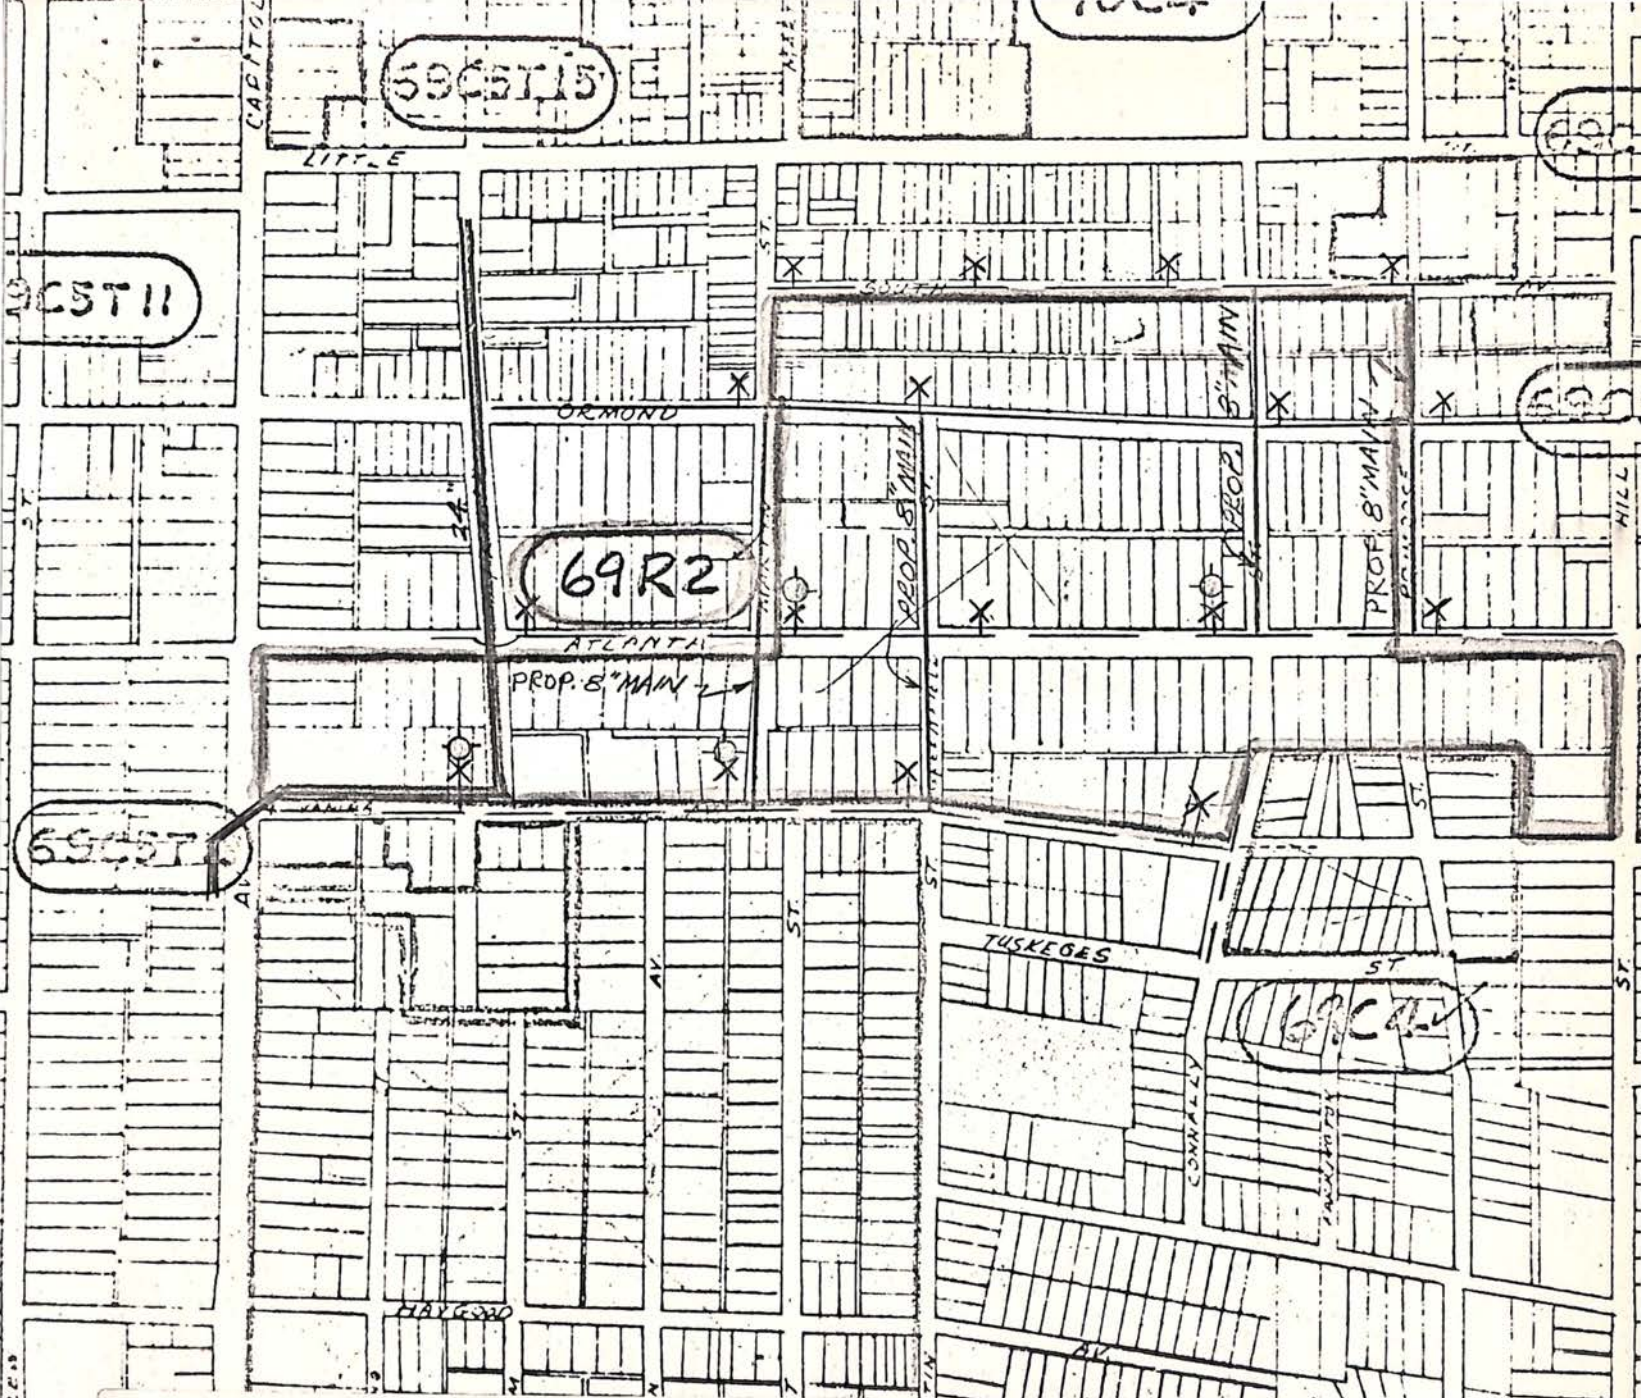







1969 Rehabilitation Area  
 1969 Clearance Area  
 Existing Water Mains  
 Proposed Water Mains  
 Existing Fire Hydrants  
 Proposed Fire Hydrants

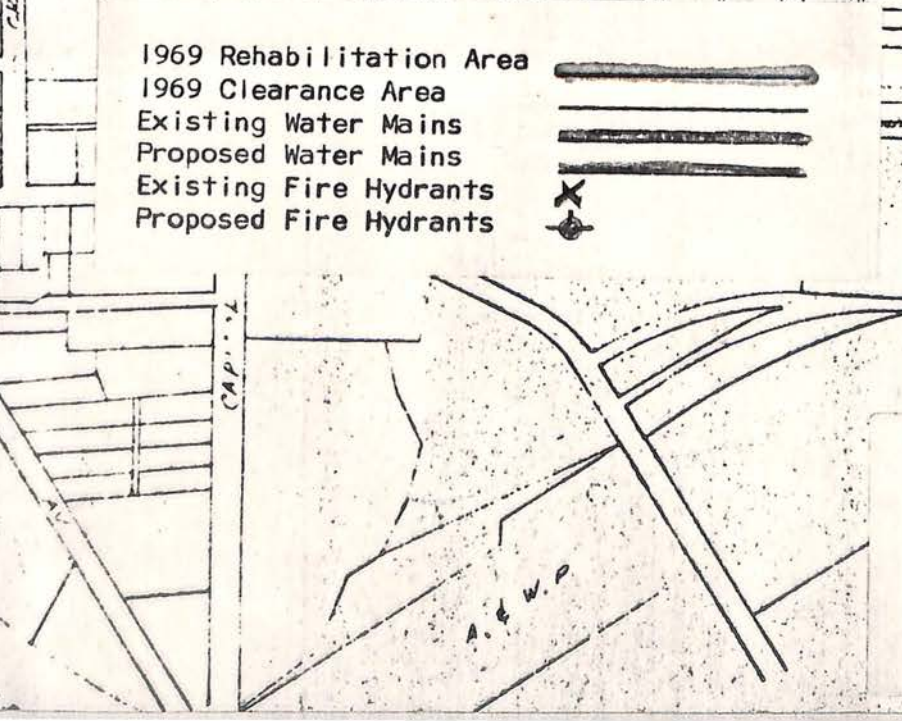


ATLANTA WATER WORKS  
 Paul Weir, General Manager  
 Division of Engineering  
 C. W. Cline, Chief Engineer





- 1969 Rehabilitation Area 
- 1969 Clearance Area 
- Existing Water Mains 
- Proposed Water Mains 
- Existing Fire Hydrants 
- Proposed Fire Hydrants 

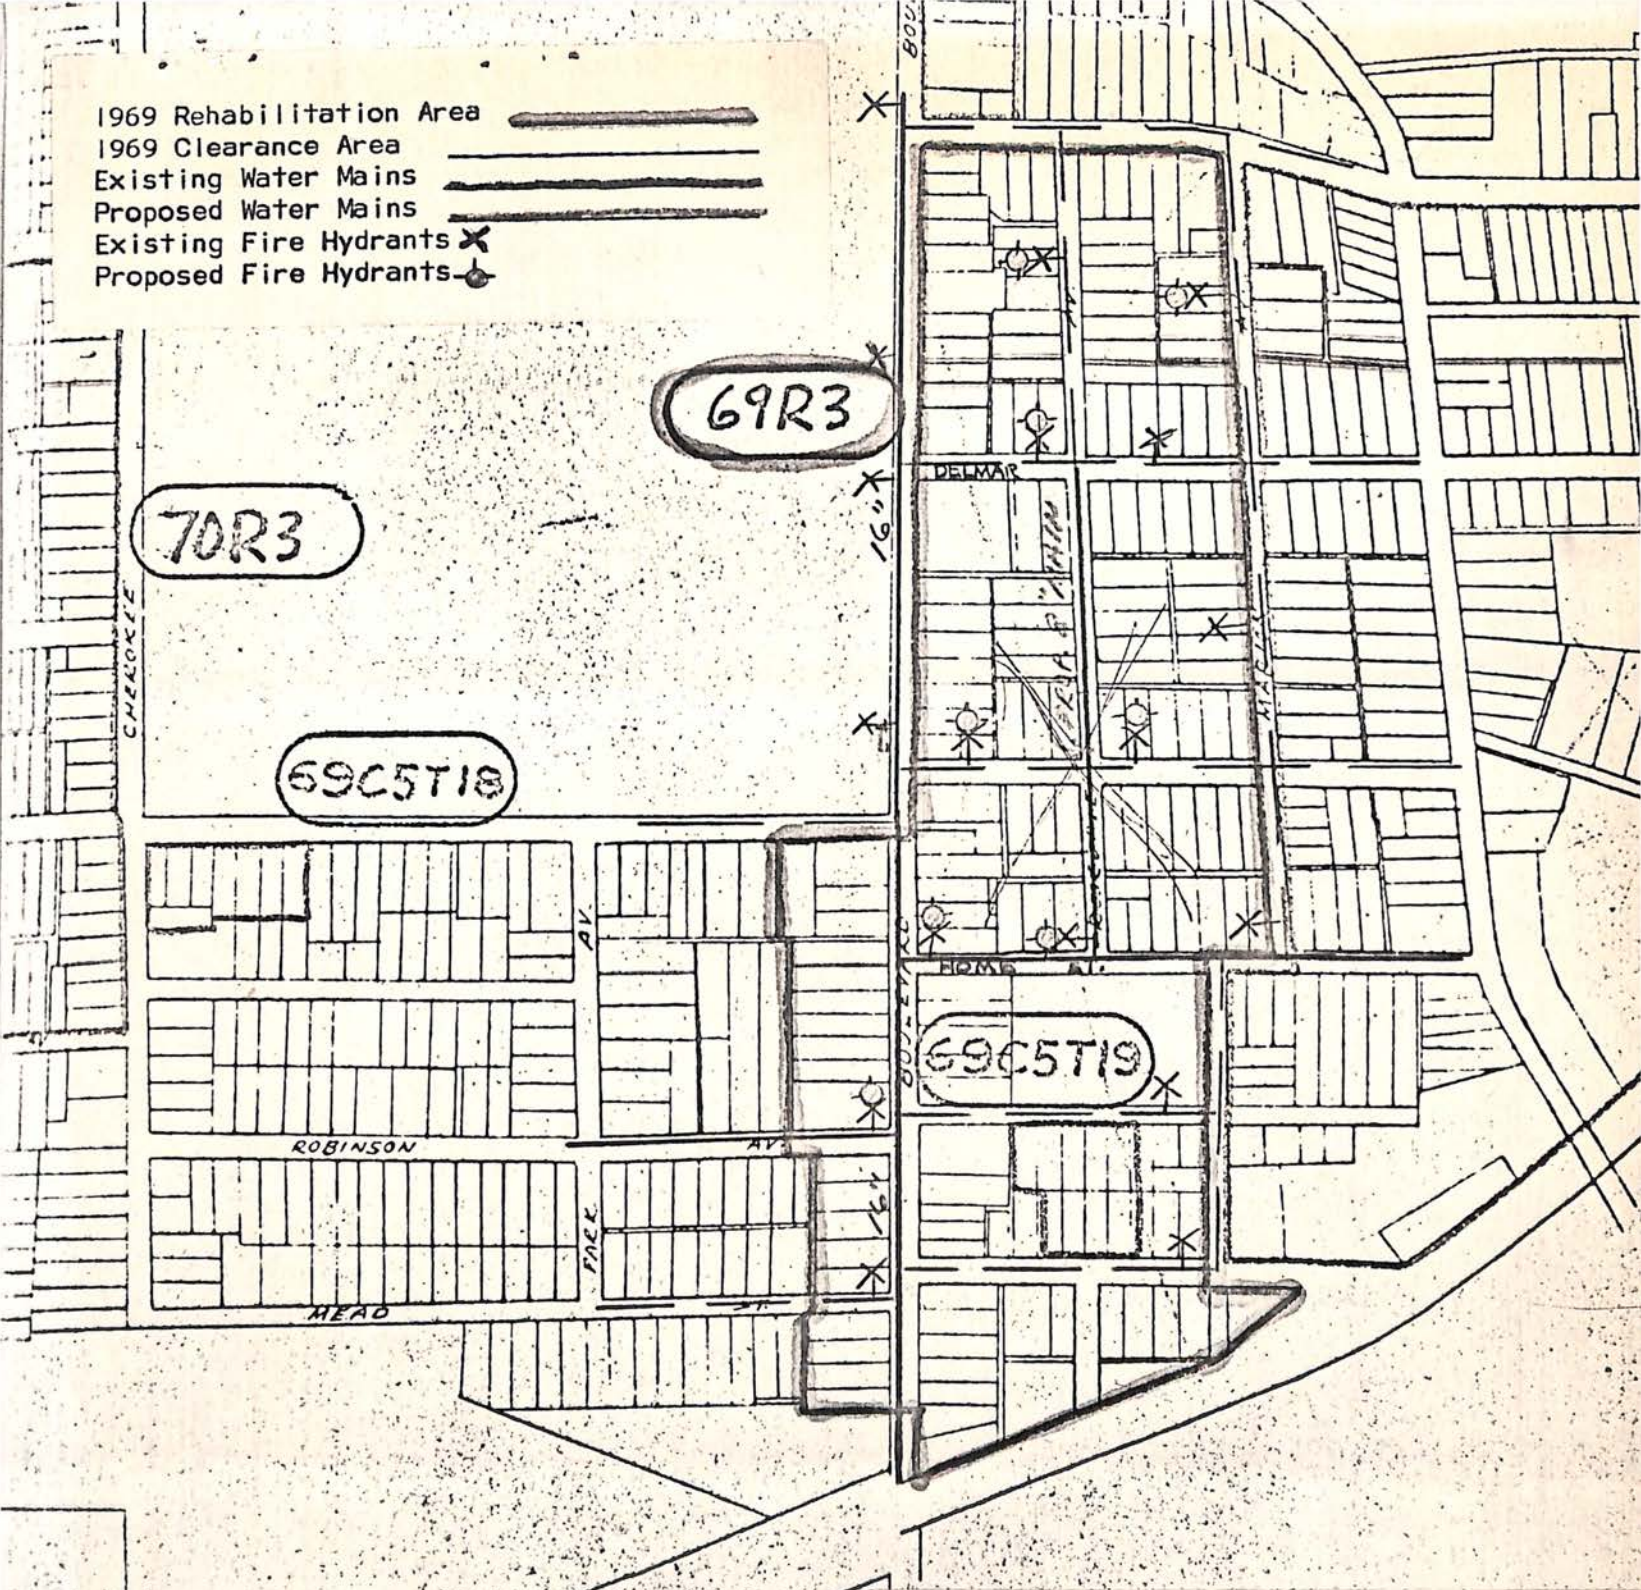

ATLANTA WATER WORKS  
 Paul Weir, General Manager  
 Division of Engineering  
 C. W. Cline, Chief Engineer

# MODEL NEIGHBORHOOD